

Four Way Special Utility District

Customer Questionnaire for Lead and Copper Testing of Drinking Water

The Four Way Special Utility District Water System is required to do Lead and Copper testing at least every three years at different locations within our distribution system. In order to compile a database of the materials used in our customer's service lines and plumbing required by our sampling plan, please take a few minutes to complete this questionnaire and return to:

Four Way Special Utility District
411 N Main St.
Huntington, TX 75949
You can fax it to 936-876-4012
Email it to
fourway@fourwaywater.com

We thank you for your cooperation in helping us with this to continue to serve clean and safe drinking water to our customers.

Contact Information

Name of Person filling out this questionnaire: _____


Phone Number should we have questions: _____

Property Information

Address (use separate sheet for each property): _____

Type: Single Family Multi-Family Commercial Industrial
Year Built: Before 1982 After 1982

Water Service Components

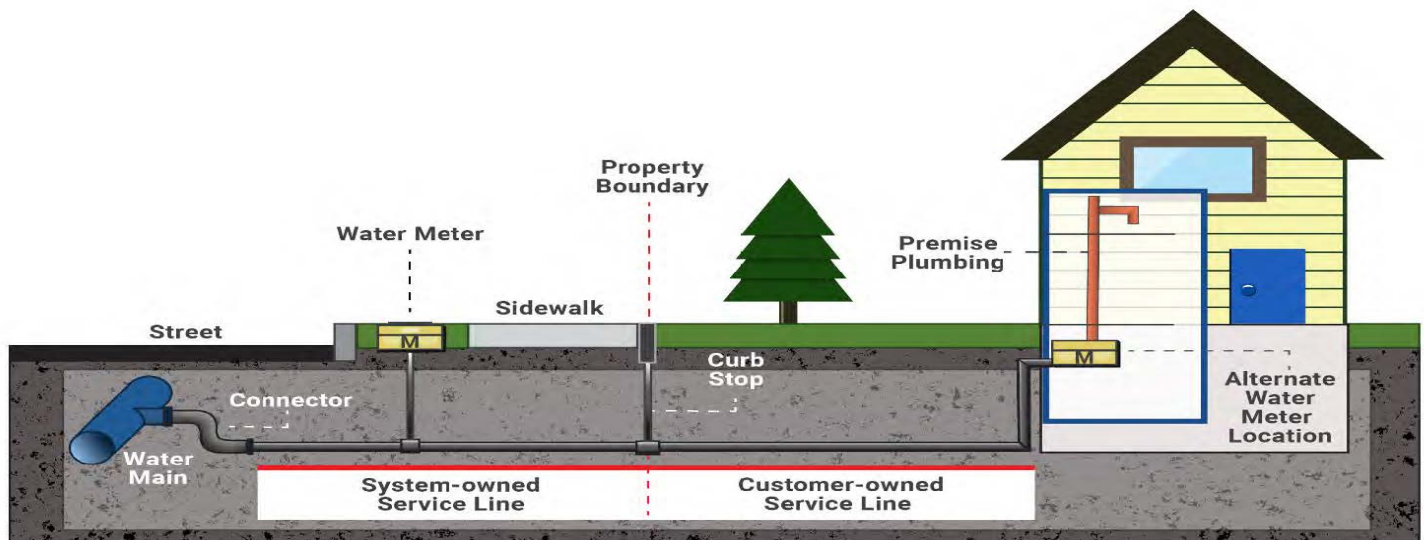

1. Water main Corporation stop (service is tapped to main)
2. System-owned Service-Line (from Corporation stop on main to customer's valve located just past the meter)
3. Customer's valve (usually located on/near property line)
4. Customer-owned Service Line (from customer valve to residence)

Materials List

1. What material is your service line (3) made of? (Check all that apply)
 Lead Copper Galvanized steel P.E. (polyethylene) Unknown
2. When was the service line going into your house or business installed?
 Before 1982 After 1982
3. What material are the pipes in your house or business made of? (Check all that apply)
 Lead Copper Galvanized PVC PEX
4. How old are the pipes inside your house?
 Installed before 1982 Installed after 1982
5. Do you have a water softener or a whole home water purification system or any other treatment device installed in your house or business?
 Yes No
6. If you answered yes to question 5, do you have an untreated, cold water kitchen or bathroom faucet?
 Yes No
7. If your home or business meets the criteria for lead and copper sampling, would you be willing to participate in this testing? During testing, a Water Supply Employee would bring an empty bottle to your house, provide you with documentation and instructions on collecting the sample, and pick it up the next morning. Sampling frequency is typically every three years.
 Yes No

Thank you for participating in this survey; the data collected will allow us to provide accurate sampling and test results to determine the level of lead and copper found in our homes and businesses and to make appropriate treatment changes to lower or eliminate lead or copper leaching from service lines, plumbing, and fixtures in our customers' homes and businesses.